

DEVELOPMENT SERVICES DEPARTMENT

SUMP PUMP CONNECTION TO VILLAGE STORM SEWER SPECIFICATIONS & REQUIREMENTS

GENERAL REQUIREMENTS

1. Contact the Village to determine if a connection to the storm sewer system is allowed.
2. Connections are subject to an inlet or other drainage structure located in the front or rear of the property. Direct connections or taps to Village storm sewer pipes are not allowed.
3. Crossing of another resident's property line will not be allowed.
4. Only perpendicular (90°) crossings of the Village right-of-way are allowed.
5. **The connection of downspouts or french drains are prohibited. Downspouts must discharge to the ground.**

SUBMITTAL REQUIREMENTS

6. A Miscellaneous Permit is required to be completed with required fee
7. Plat of survey with: easements, piping, size, material; structure connection; and landscaping restoration.
8. A copy of the contractor contract describing the work. Homeowner cannot complete work in Village right-of-way.

PIPING REQUIREMENTS


9. Pipe shall be solid 4-inch PVC pipe SDR 26 or SDR 35 at a minimum 1% slope.
10. A 3-inch air gap is required where the sump pipe exits the home prior to connecting to the 4-inch pipe.
11. If the pipe crosses Village right-of-way, a cleanout "tee" shall be installed over the 4-inch pipe 2-feet from the right-of-way line. The top of the tee shall have an open grate no higher than existing ground.

CONNECTION TO STORM STRUCTURE

12. Connection to storm structure must be core drilled and patched with non-shrink grout.
13. The 4-inch pipe shall not protrude more than 2-inches into structure.
14. Contact the Village prior to backfilling connection for inspection and approval.

RESTORATION REQUIREMENTS

15. Sod restoration is required for all work within the Village Right-Of-Way.
16. Installer assumes full responsibility & liability for any damage to Village right-of-way and utilities.

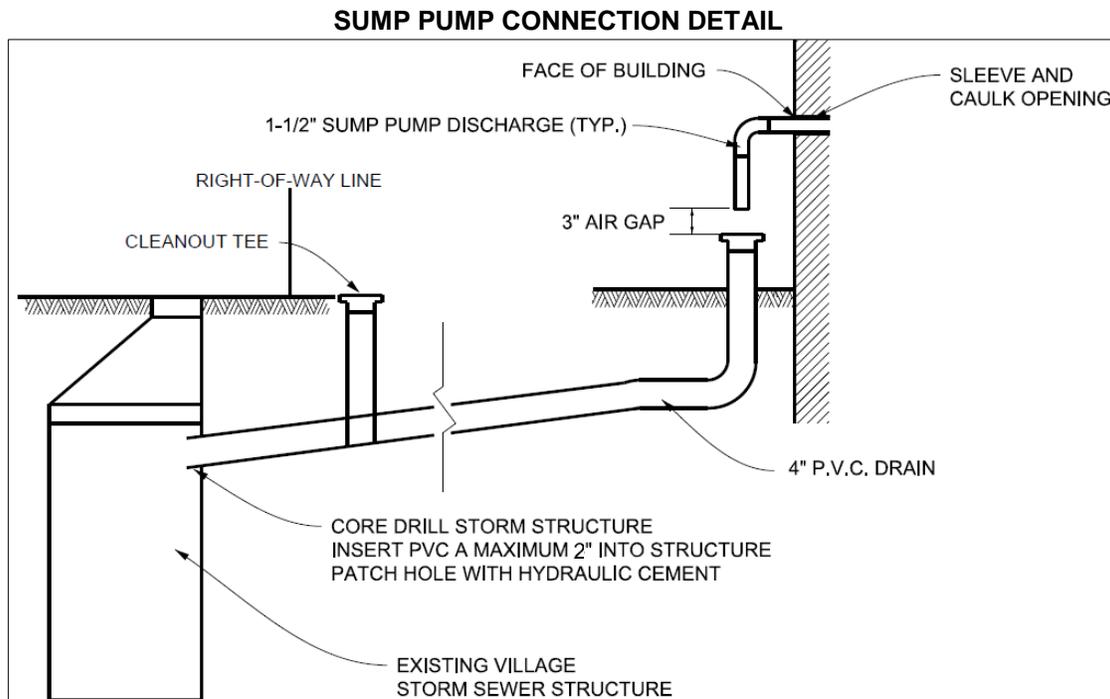

I hereby certify that I am installing the sump pump connection within Village right-of-way and/or easements at my own risk. The Village or utility companies are not liable for damage, replacements, and/or relocations to any portion of sump pump pipes and connections located in the right-of-way or easements for any future work which may be performed.

Signature: _____

Date: _____